





# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-600-699 WELL#=699-S31-E10C

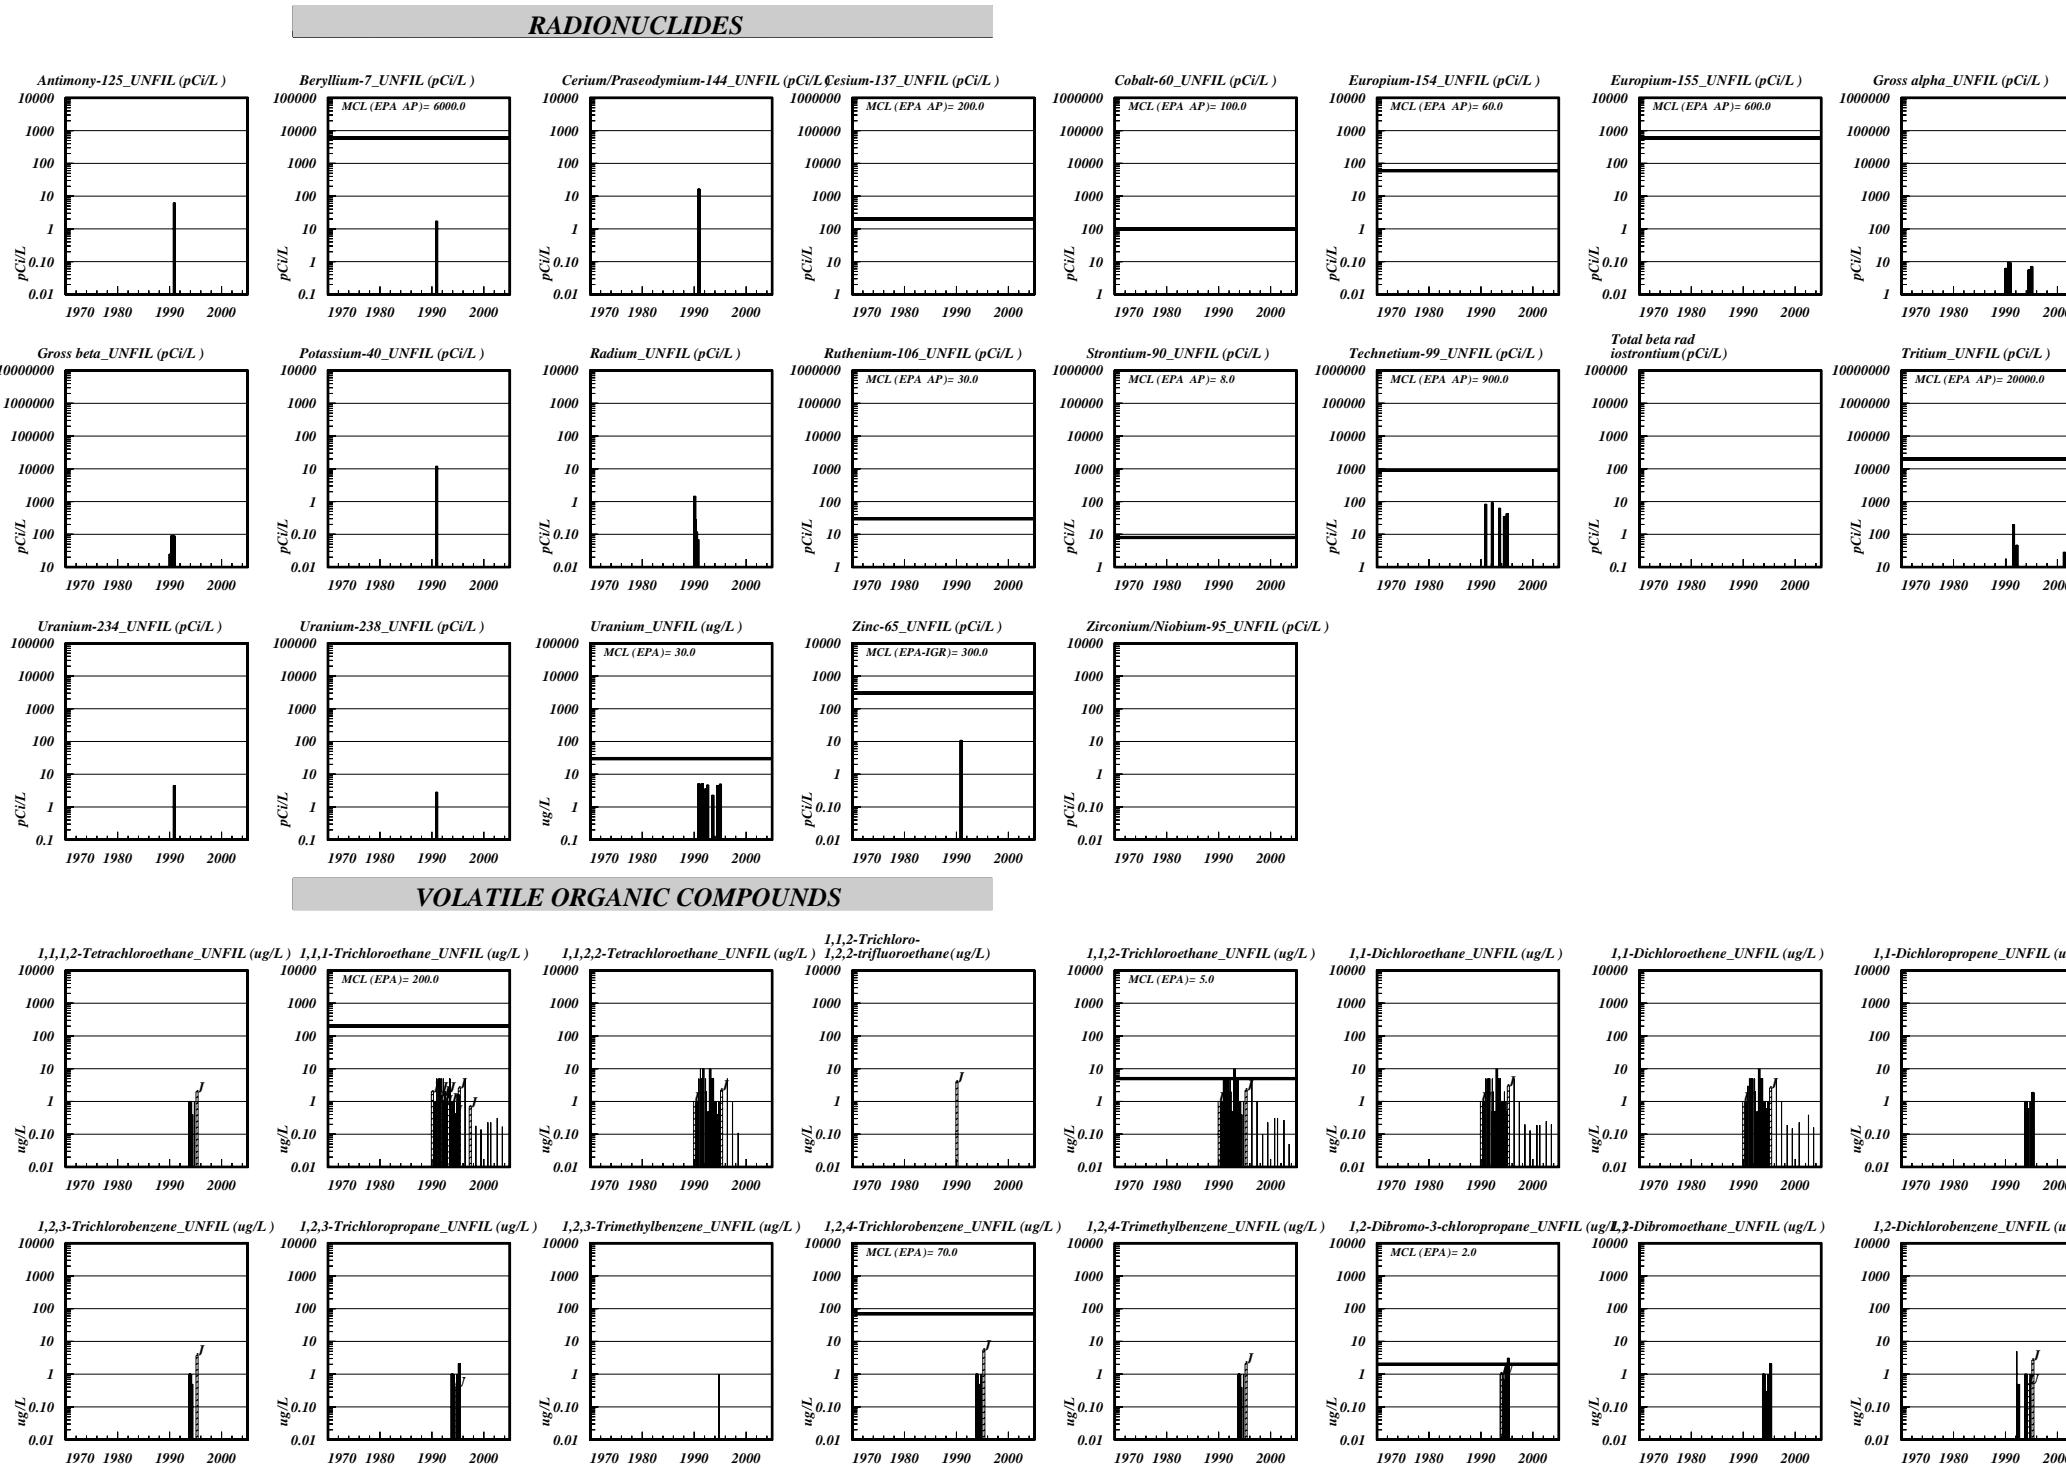

LABORATORY QUALIFIER FLAGS in HEIS are \*; >; B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

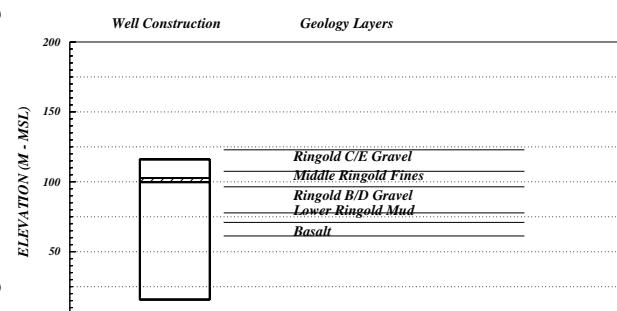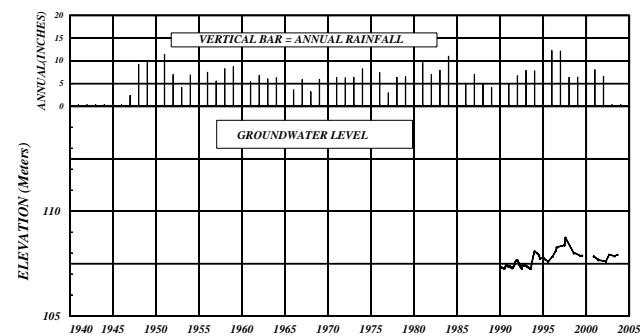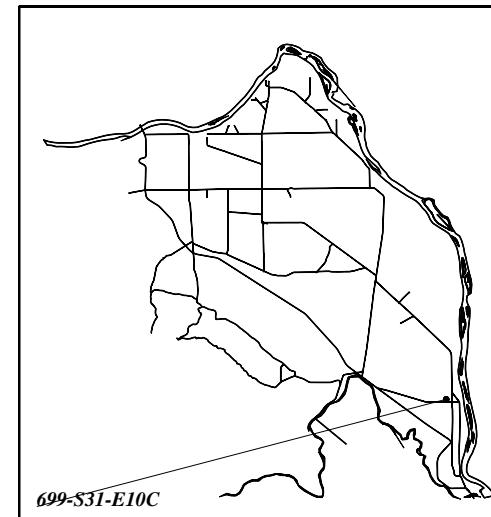


**WELLNAME=699-S31-E10C WELLID=A5381**  
 Well Type=STANDARD Well purpose=GROUNDWATER  
 Owner=DOE Contact=BHI Well Adm Compliance=NON-COMPLIANT  
 X\_coor=592966.90 Y\_coor=114154.70 Datum=NAD83(91) Date Survey=11/30/1992  
 Elevation= 116.007 Datum=NGVD29 Date Survey=10/17/92  
 Ref\_Point\_Desc=BRASS CAP Ref\_Point\_side=NONE Contractor=USACE(JECA)  
 Total Number of perforation Intervals=1  
 NPERF#=1 Perf\_top= 103.22 Bot= 100.17 MCas\_size= 0.00 Perf\_cuts= 0.00  
 Total Number of Screen Intervals=1  
 Screen#=1 Screen\_diam= 4.00 in Top= 13.28 Bottom= 16.33 m Slot\_size= 0.01 in  
 Screen\_material=Stainless Steel  
 Total Number of Seals=5  
 Seal#=1 Depth\_top= 0.61 Bottom= 5.67 m Material=Portland Cement  
 Seal#=2 Depth\_top= 5.67 Bottom= 8.55 m Material=Bentonite Crumbles  
 Seal#=3 Depth\_top= 8.55 Bottom= 11.66 m Material=Bentonite Pellets  
 Seal#=4 Depth\_top= 11.66 Bottom= 16.45 m Material=Colorado Silica Sand  
 More Information is at <http://www.envirodataaccess.com/wellfiles/699-S31-E10C.htm>

# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS



wellseries-600-699 WELL#=699-S31-E10C

## VOLATILE ORGANIC COMPOUNDS

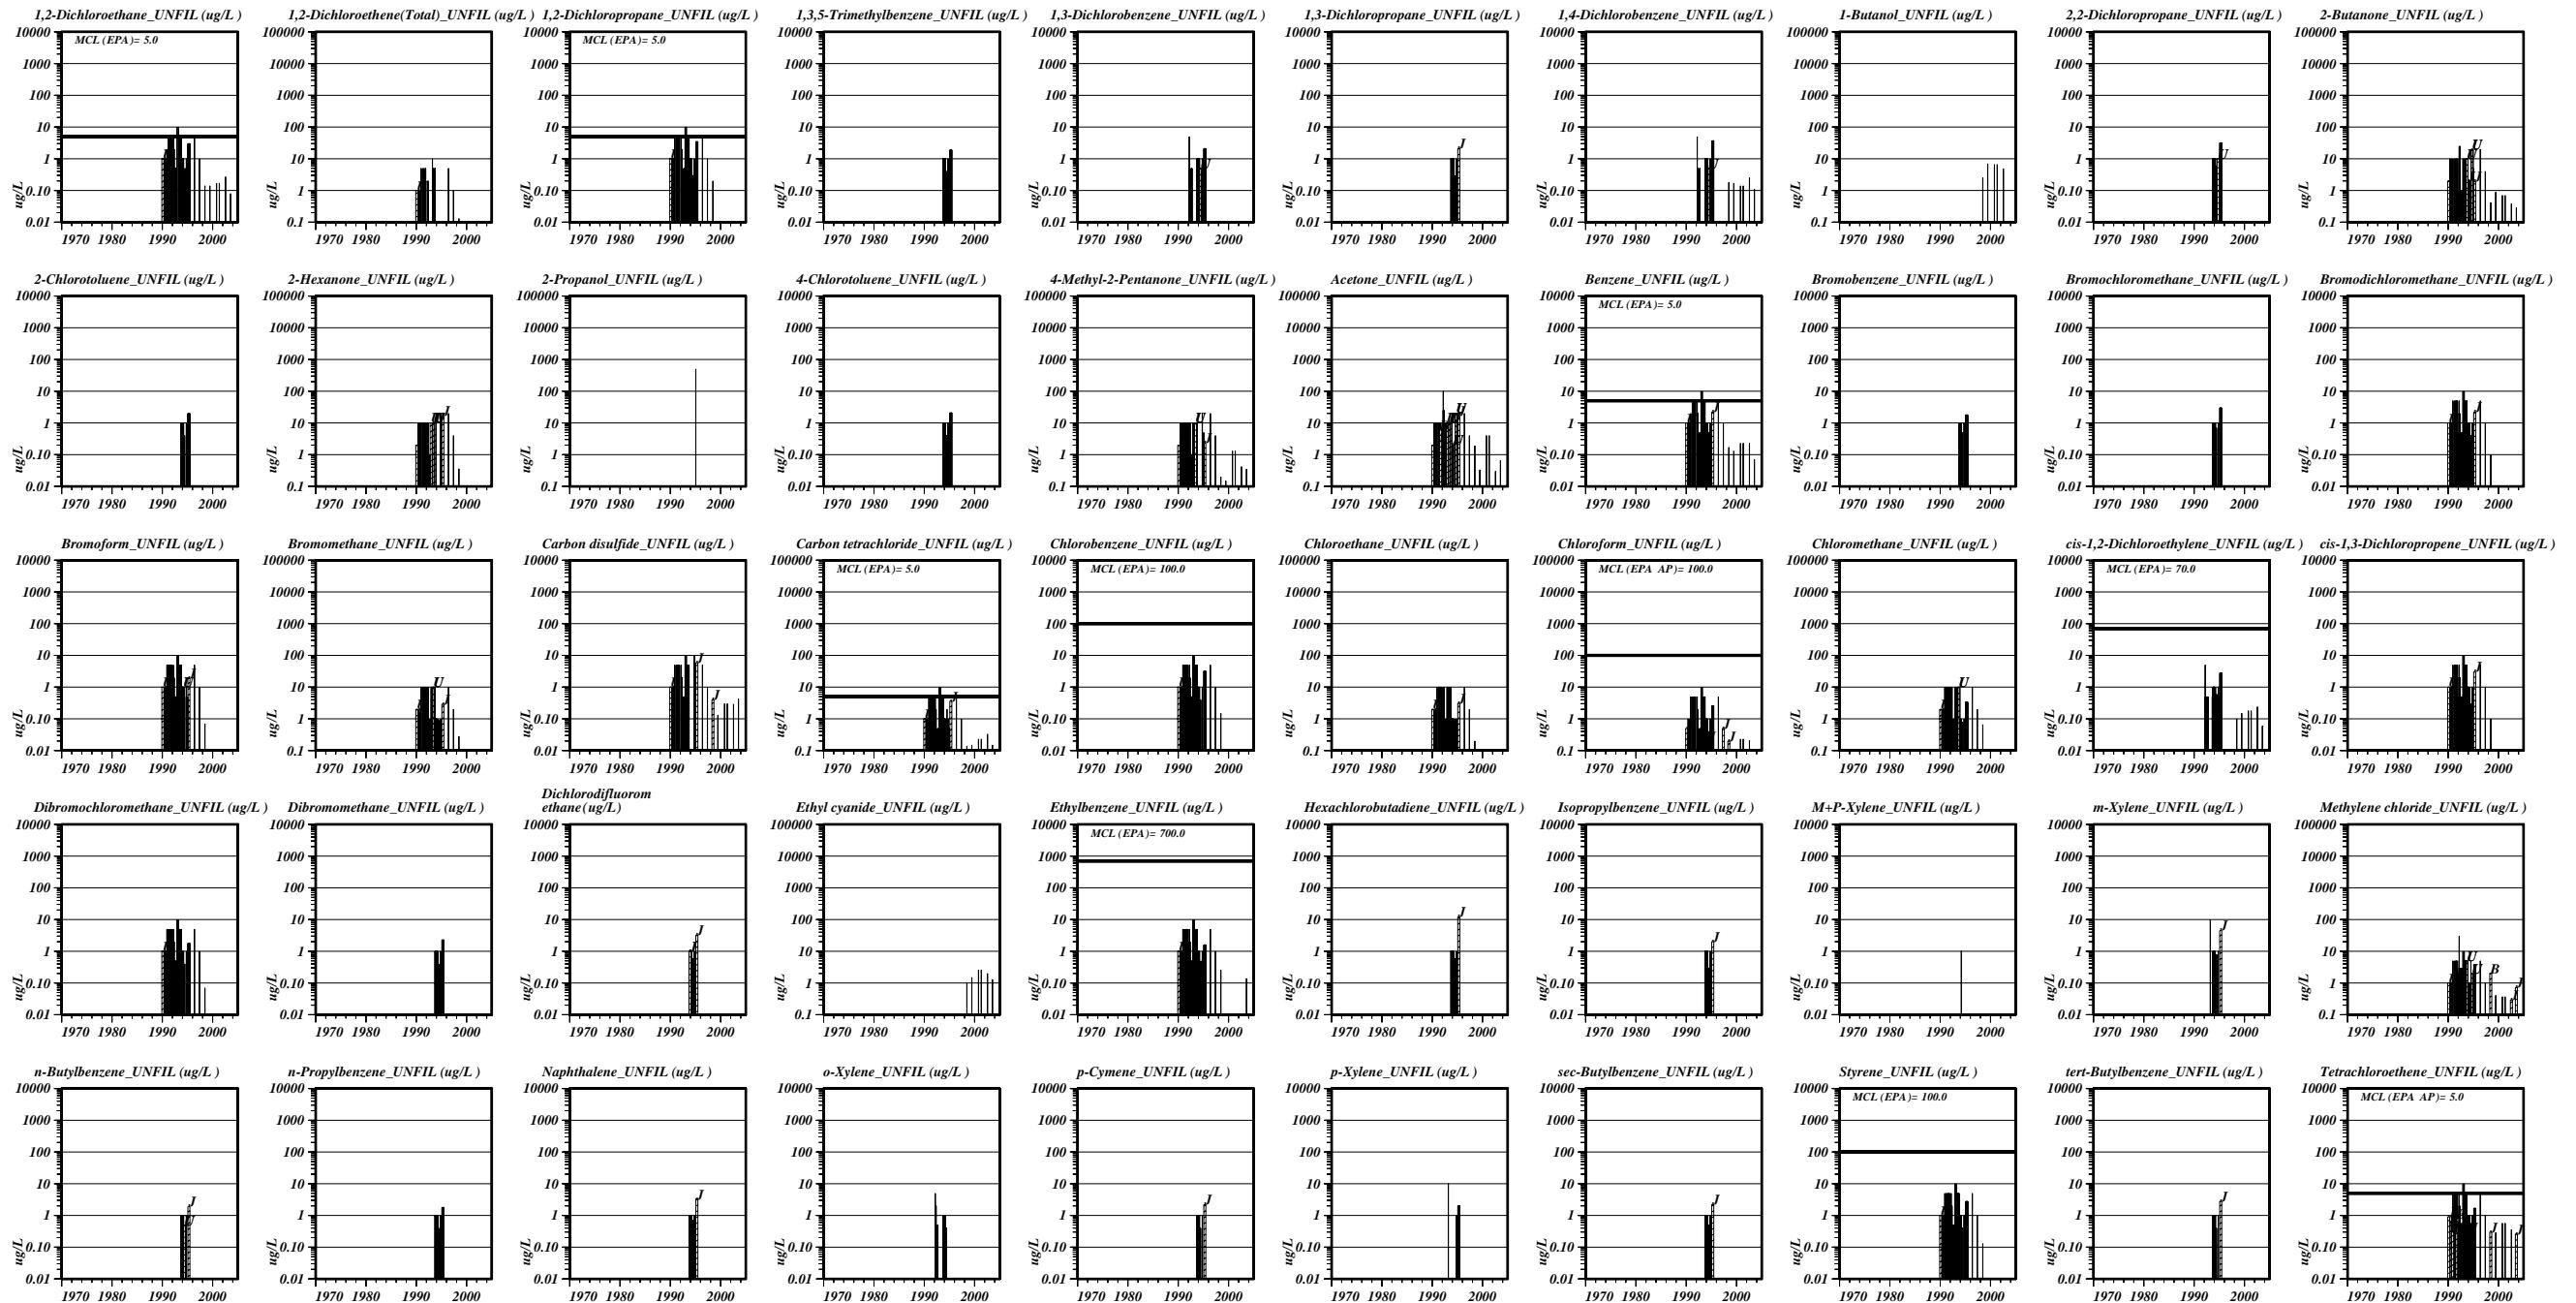



LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag

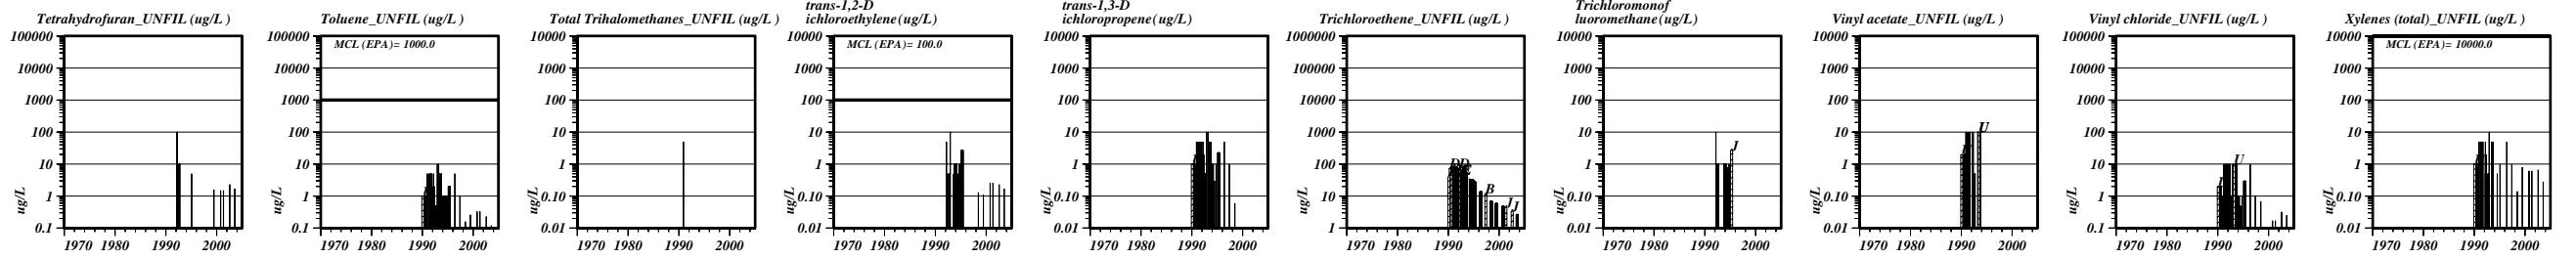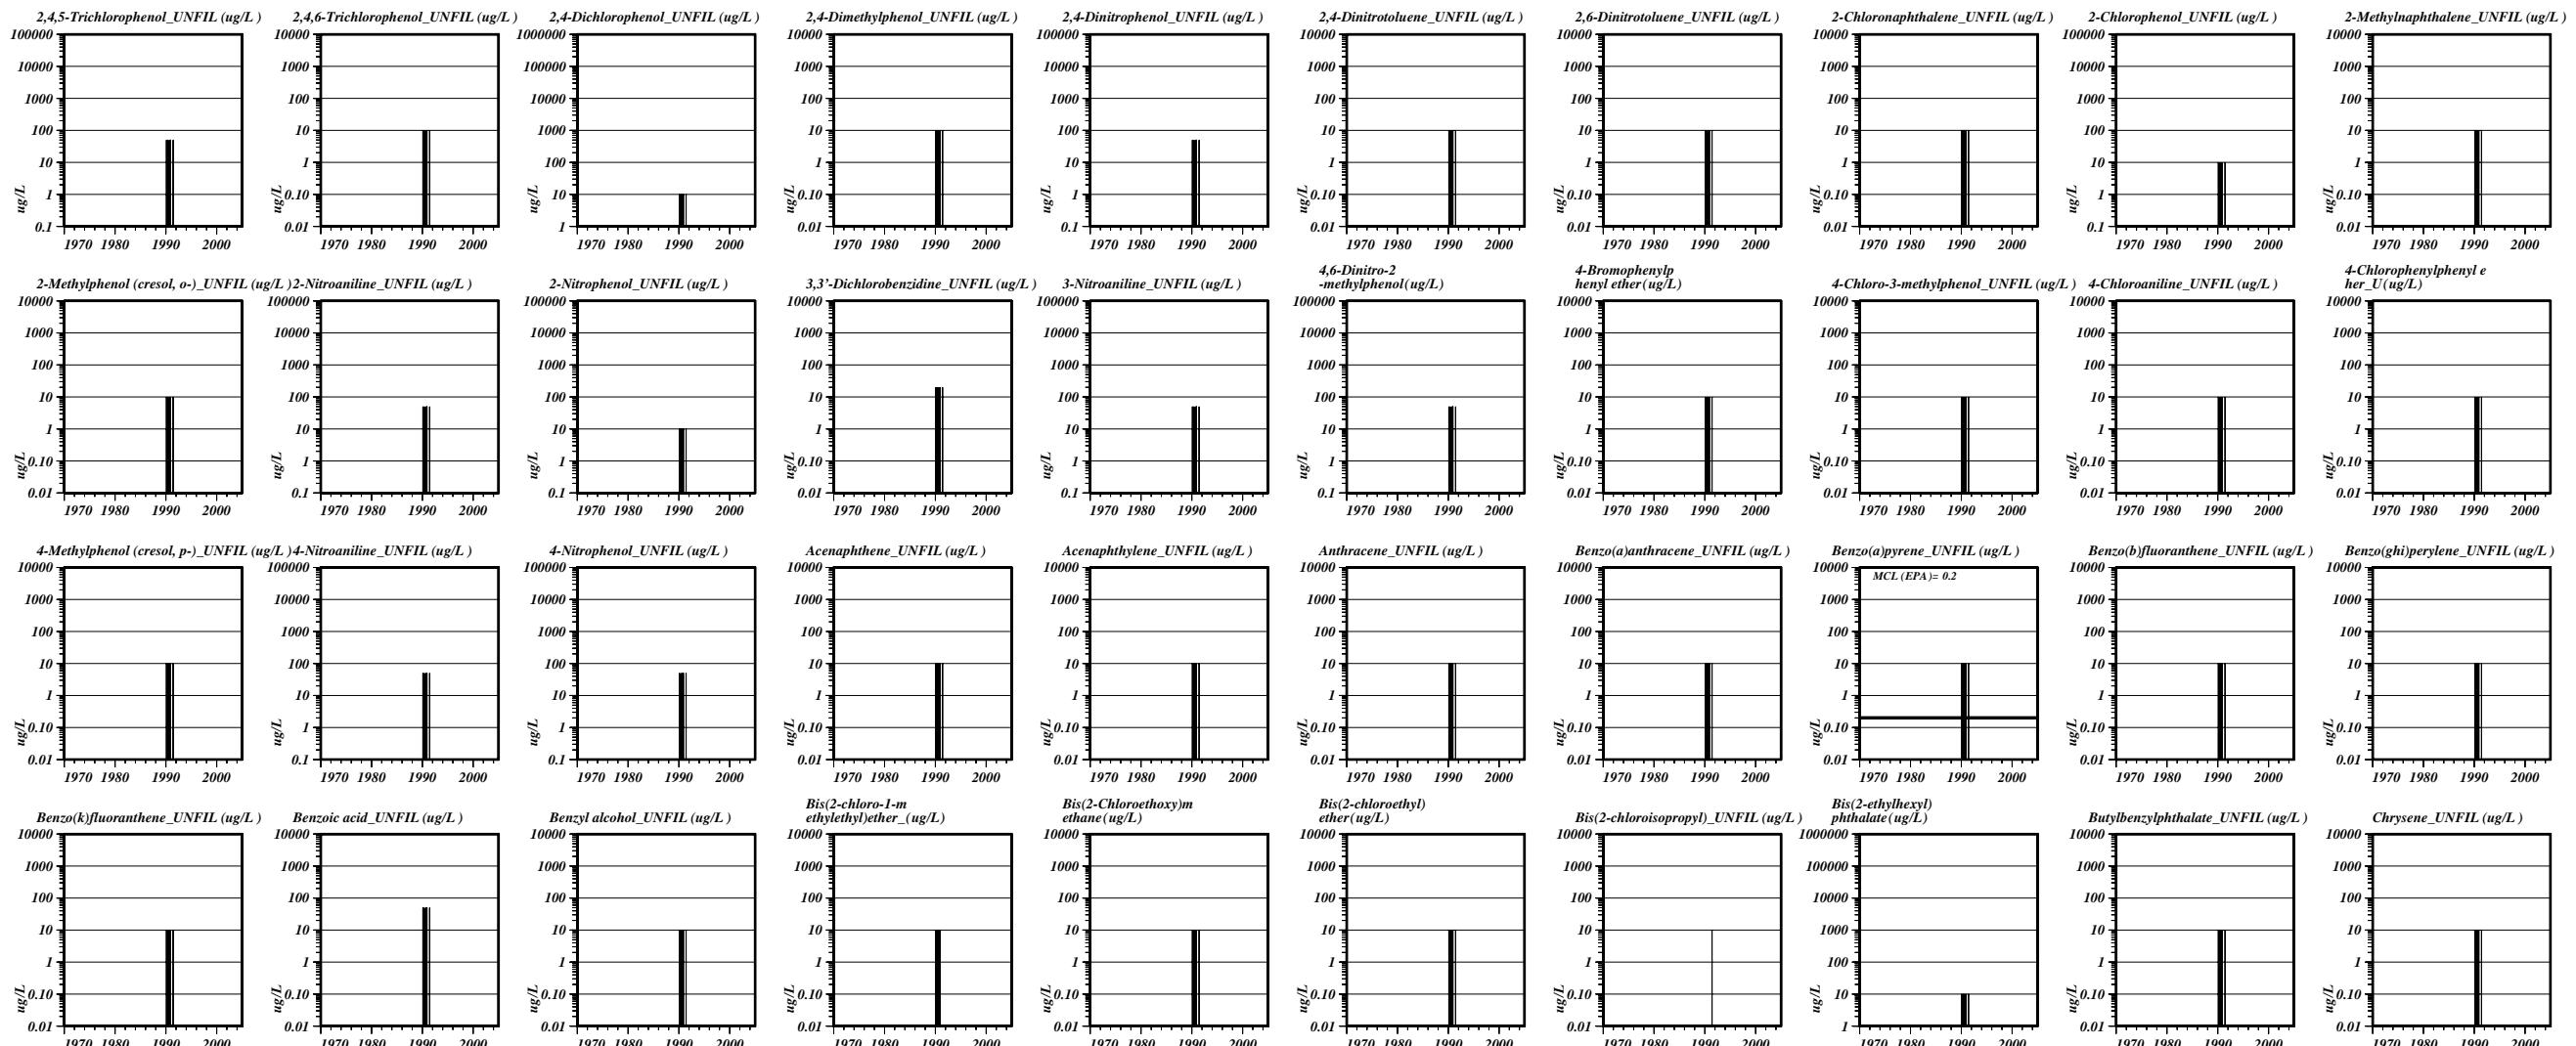**VOLATILE ORGANIC COMPOUNDS****SEMI-VOLATILE ORGANIC COMPOUNDS**

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

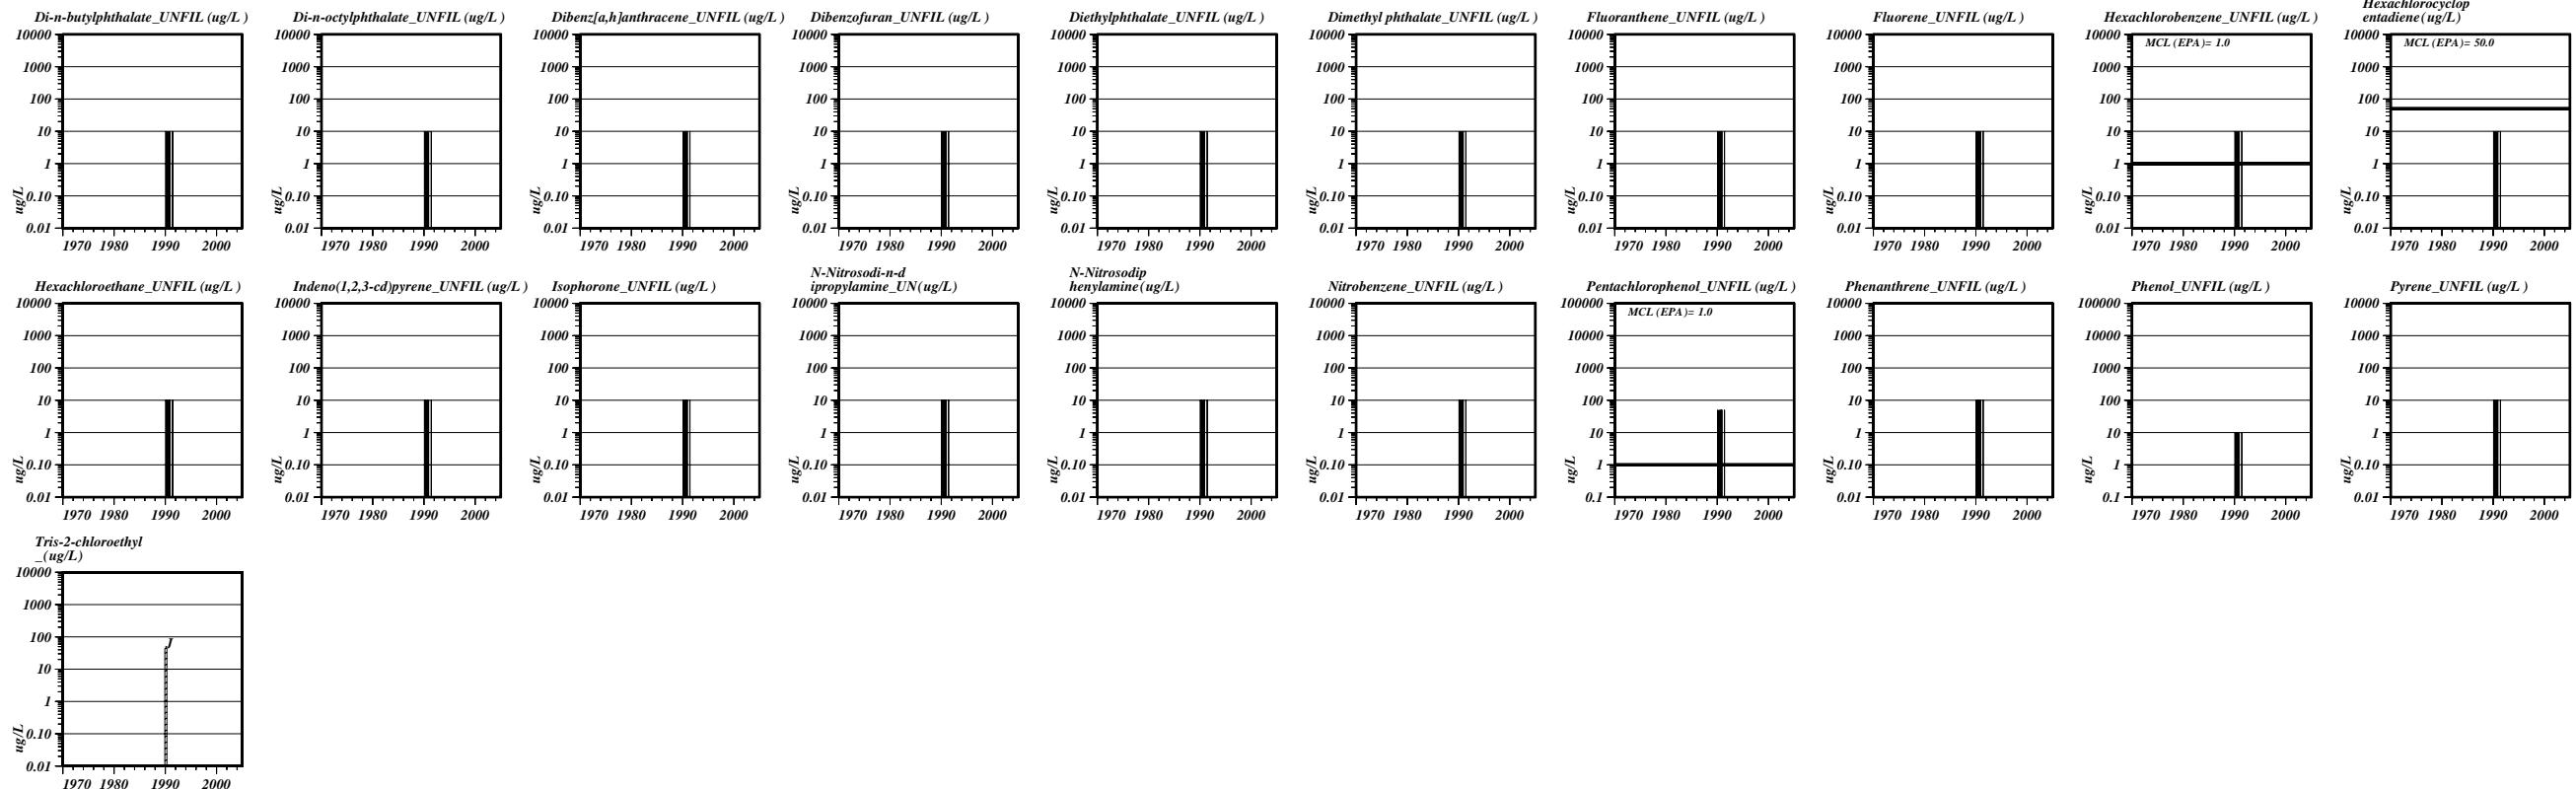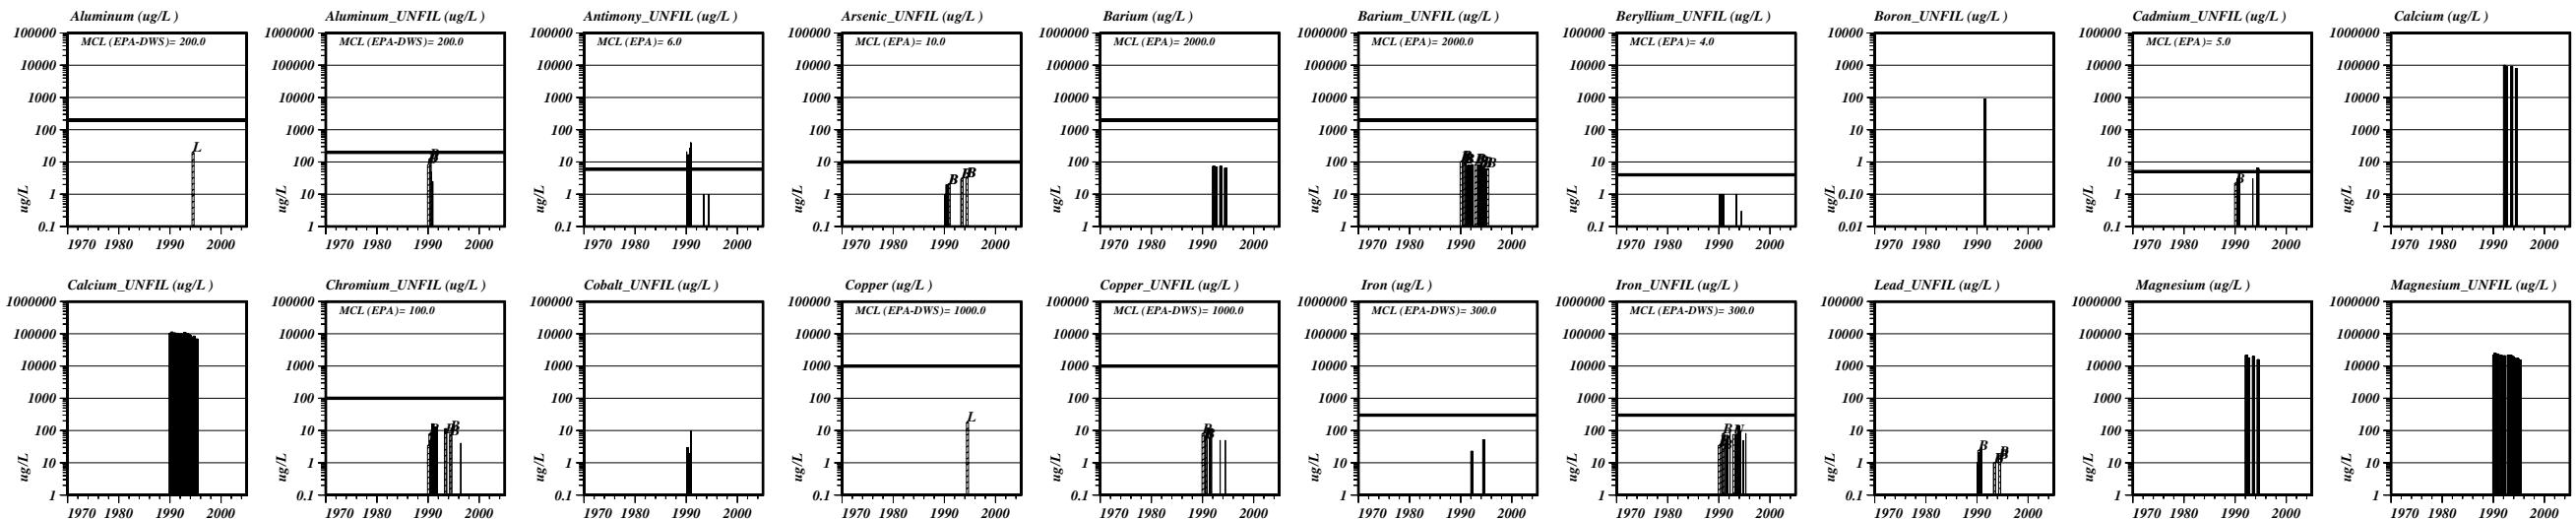**SEMI-VOLATILE ORGANIC COMPOUNDS****METALS & PHYSICAL PARAMETERS**


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-600-699 WELL#=699-S31-E10C

## METALS & PHYSICAL PARAMETERS

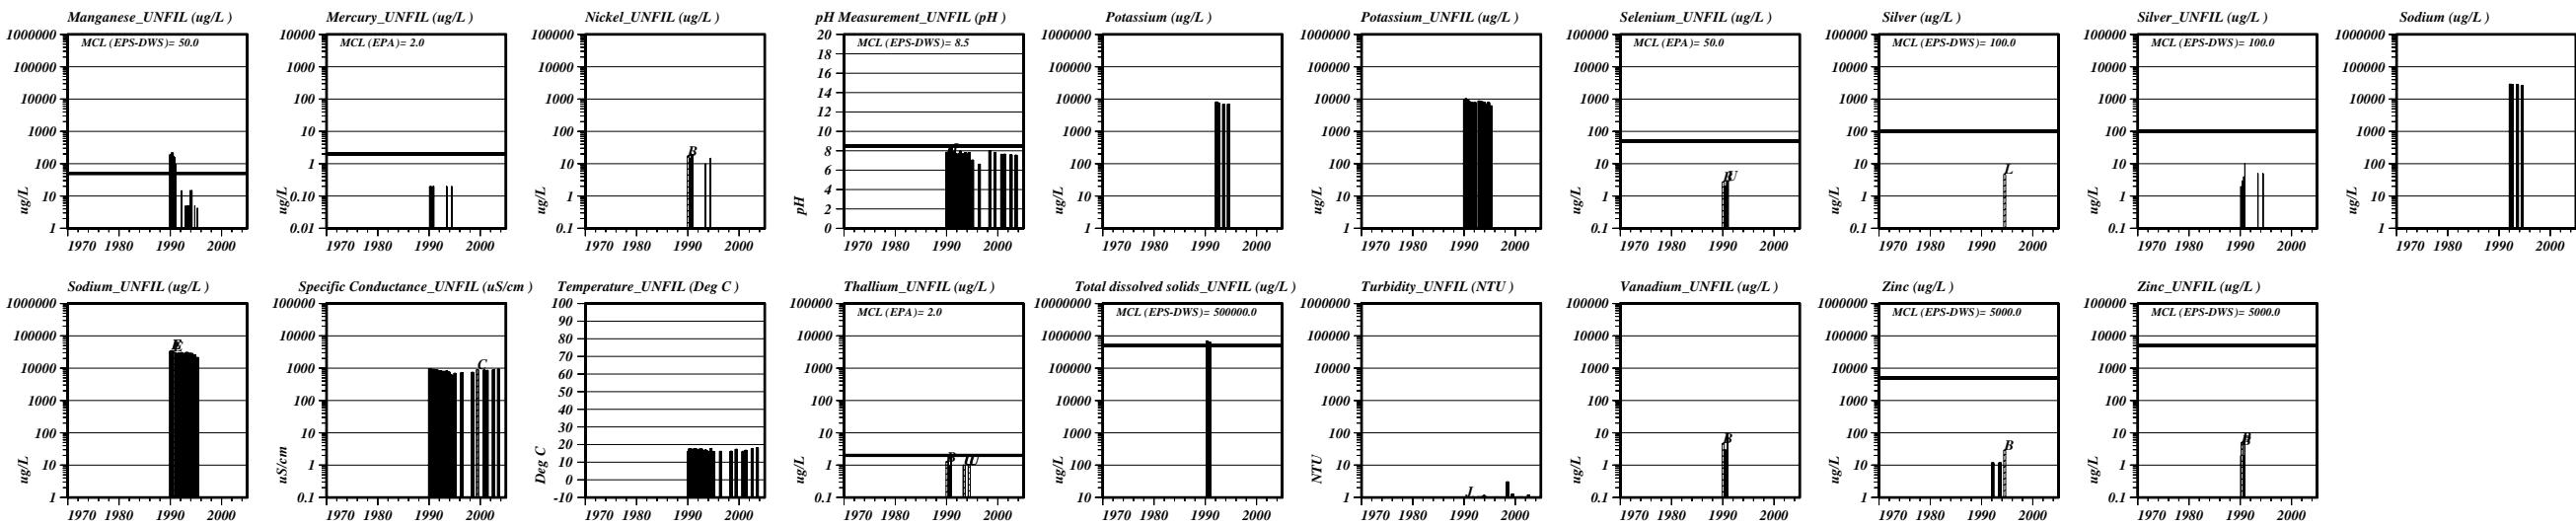


## PEST/PCB, HERB, & DIOXINS

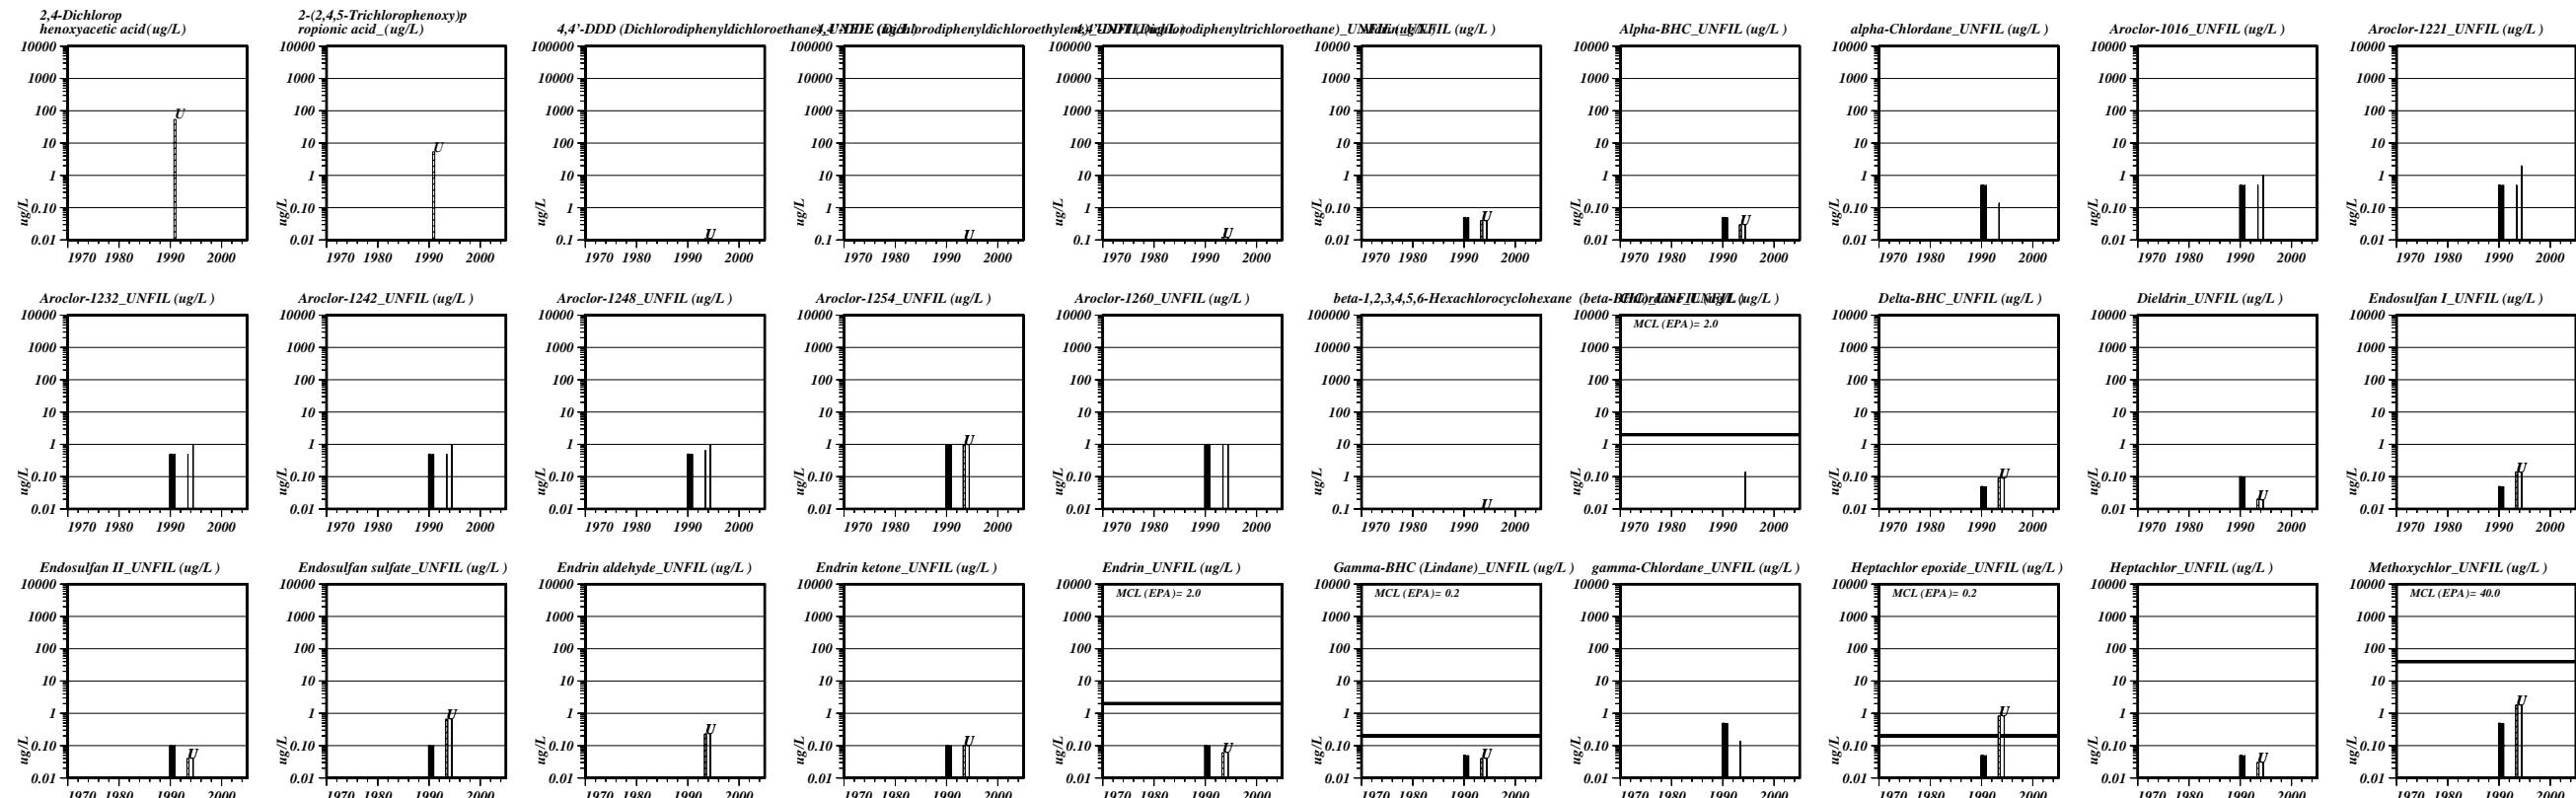


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

## PEST/PCB, HERB, &amp; DIOXINS



## GENCHEM &amp; ORGANICS &amp; GENORGANICS

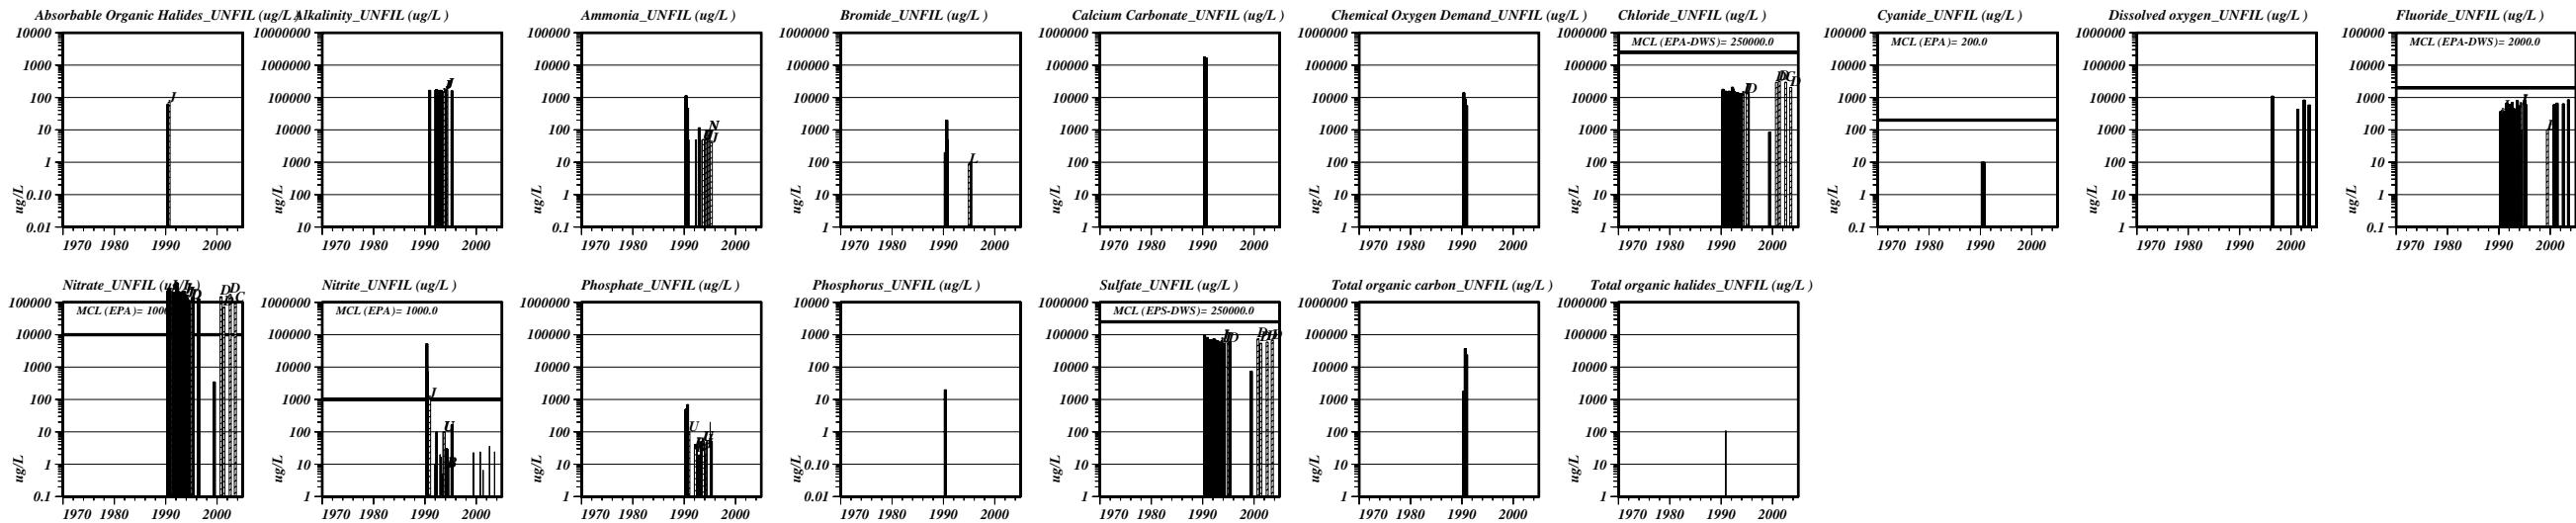

LABORATORY QUALIFIER FLAGS in HEIS are \*; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag